

ExactLogic BACnet Communicating Thermostat

EXL01614 Sequence Datasheet

BACnet VVT RTU with Zone



BACnet is a registered trademark of ASHRAE. ASHRAE does not endorse, approve or test products for compliance with ASHRAE standards. Compliance of listed products to requirements of ASHRAE Standard 135 is the responsibility of the BACnet International. BTL is a registered trademark of the BACnet International.



DataSheet Rev 1.20.001/4.4
October 9, 2023

Operating Sequence

Standard Occupied

Thermostat occupancy can be set from a number of different sources. The Occupied Schedule Command at BO-5, a Warmup Command at BV-41, a Cooldown Command at BV-42, an External Occupancy Sensor at BI-5, the Optional Internal Occupancy Sensor at BI-1, or from the Field Service Mode. The External Occupancy Sensor is enabled with BV-51, and the Internal Occupancy Sensor is enabled at BV-64. See the separate Installation documentation to set the occupancy from the Field Service Mode.

During normal occupied operation the display will show the current room temperature. The first press of either right pair of keys will show the current room setpoint. Additional presses will adjust the setpoint up or down by 0.5 degrees. The thermostat keypad will time out after 5 seconds without a key press, and the display will switch back to displaying the room temperature.

The left pair of keys allows for the adjustment of the fan speed. The current mode is shown with the first key press; additional key presses will show the adjustment to the mode. AV-62 is used to select the number of fan speeds, and AV-63 will show what speed the fan is currently set to. Refer to the table below for the values of AV-62 (Fan Mode Status) and AV-63 (Fan Speed Status)

AV-62	Mode
0	AUTO Only
1	AUTO-ON
2	OFF-AUTO-ON
3	OFF-1-2-AUTO
4	OFF-1-2-3-AUTO

AV-63	Fan Speed
0	OFF
1	Fan Speed 1
2	Fan Speed 2
3	Fan Speed 3
4	AUTO
5	ON

Thermostat Temperature Control

Internal/External Thermistor

This mode is used to select the internal thermistor on AI-0 or the external thermistor on AI-2. The control decision is made by BV-67. BV-63 must be OFF for this mode.

Control Sequence – Heat / Cool

When scheduled to be occupied, VVT Request AV-40 will maintain heating and cooling control. VVT Request AV-40 uses values -100 to 100 to decide heating and cooling. Positive 100 is a request for full heating and negative 100 is a request for full cooling.

If VVT Request AV-40 reaches -20 the request for Cooling Stage 1 turns on. It will turn off at -15. If VVT Request AV-40 reaches -60 Cooling Stage 2 turns on. It will turn off at -55.

If the Discharge Air Temp AV-21 Reaches 53° it will shut down Cooling stage 2 and will reset once the Discharge Air Temp AV-21 reaches 61. If the Discharge Air Temp AV-21 Reaches 50° it will shut down Cooling stage 1 and will reset once the Discharge Air Temp AV-21 reaches 58.

If VVT Request AV-40 reaches 20 the request for Heating Stage 1 turns on. It will turn off at 15.

If the Discharge Air Temp AV-21 Reaches DAT High limit it will shut down Heating Stage 1 and will reset once the Discharge Air Temp AV-21 reaches 100.

Control Sequence – Damper Control

When scheduled to be occupied, Damper Command ASO-0 will modulate to Room Temp AV-20. This will modulate to Current Heating Set Point AV-4 and Current Cooling Set Point AV-5. It will modulate from a heating to cooling demand based on Warm Air in Duct BV-8.

Standard Unoccupied

During unoccupied operation the thermostat will continue to display the room temperature. When in an unoccupied state pressing one of the right pair of keys will display a message indicating the thermostat is in night mode, preventing the setpoint from being adjusted. To adjust the room setpoint when unoccupied the thermostat must be set to night override.

Control Sequence

When in the unoccupied mode, the room will be controlled by the unoccupied cooling/heating setpoints. The fan and cooling/heating stages will operate the same as the occupied control sequence.

Vacancy

If a room is known to be vacant, vacant setpoints can be used to override the unoccupied setpoints. By setting BV-70, a room will be controlled by the vacant cooling/heating setpoints (AV-64/65).

Night Override

Set the night override by pressing one of the left pair of keys. The display will switch to allow the user to set the night override time. Additional presses of the keys will adjust the time up or down by 0.5 hour increments. The night override can be increased up to the override limit set at AV-73, the default is 5 hours. When the thermostat is in night override, the first press of one of the left pair of keys will display the override time remaining. Additional key presses will add/subtract 0.5 hours to the time that was remaining. When the timer reaches zero the thermostat will return to the unoccupied mode. In the night override mode, the right pair of keys can be used to adjust the room setpoint. The thermostat keypad will time out after 5 seconds without a key press, and the display will switch back to displaying the room temperature.

The thermostat can be set to a night override by writing a value to AV-74 through BACnet. The value can not exceed the night override limit set at AV-73. If the night override time is set higher than the limit, the night override timer will be set to the limit. The night override limit default is 5 hours.

If the thermostat is commanded to the occupied mode while in night override, the override timer will be cleared to zero and the thermostat will enter the occupied mode.

Control Sequence

When the thermostat is in the override mode, the room will be controlled by the occupied cooling/heating setpoints. The fan and cooling/heating stages will operate the same as the occupied control sequence.

Note: There is no fan control in the override mode. The fan will run in the AUTO mode.

Hotel Mode

The Hotel Mode is used to control the occupancy of a room. The Hotel Mode is set by commanding BV-74 to active. In this mode, the thermostat has AI-1 and AI-2 connected to motion detectors. The motion detectors are used to determine if someone is in the room or has just left the room. AI-1 is used to detect motion in the room, and AI-2 is used to detect motion at the door to the room.

If motion is found in the room the thermostat will set BO-5 indicating occupancy. If motion is detected at the door, two conditions exist. Either someone has just entered the room, or someone has just left the room. If motion is detected in the room after the door detector was set, someone just entered the room. The room will then be set to occupied. If no motion is detected in the room after the door detector was set, someone just left the room. In this condition the room will stay occupied for 15 minutes before going unoccupied. If there is motion detected within the 15 minutes, the timeout will reset and the room will continue to be occupied.

Vacancy

If a room is known to be vacant, vacant setpoints can be used to override the unoccupied setpoints. By setting BV-70 to active, a room will be controlled by the vacant cooling/heating setpoints (AV-64/65).

Motion/Humidity Option Card

The Motion/Humidity Option Card can be used for Motion Only, Humidity Only, or Motion/Humidity together. In order to use the Motion Sensor (either stand alone or with Humidity), BV-64 must be set to ACTIVE. The Humidity Sensor can be enabled by setting AV-31 to 4. These settings will automatically provide the required voltage to power the sensors. The motion sensor status will show on BI-1.

When the motion sensor, senses motion, it puts the unit in occupied “Active” Mode by writing to the Scheduled Occupied Command BO-5 at priority array entry 11, this will remain active until it does not see any motion for the entire duration of the time delay (AV-81 Units=seconds), it will then return to an inactive state.

When the internal occupancy sensor is enabled by setting BV-64 to ACTIVE, the occupied mode is controlled only by the occupancy sensor. The optimum start warmup point, BV-41, and optimum start cooldown point, BV-42, will set the unit to the occupied mode and then return to the unoccupied mode until motion is sensed. The Humidity value is shown on AI-1.

The Humidity Sensor will automatically be scaled by setting AV-31 to 4.

Disabling of the Splash, Setup Menu, or Field Service Mode

When the thermostat is installed in a public location there may be times when the setup of the thermostat will need to be disabled to prevent tenants from changing the configuration while still giving them access to change the setpoints and control after hours modes. The following points have been added to allow this:

- BV-57 = Setting ACTIVE will disable the “EXACTLOGIC” splash display after key presses
- BV-58 = Setting ACTIVE will disable access to the Setup Menu where the Network/MAC/Baud Rate/etc are set
- BV-59 = Setting ACTIVE will disable access to the Field Service Mode where Time/Schedule/Setpoints/etc are set

Lighting Control

When the Lighting Occ Sensor BI-4 it will command BO-4 for the Lighting Off Delay AV-36.

Installation

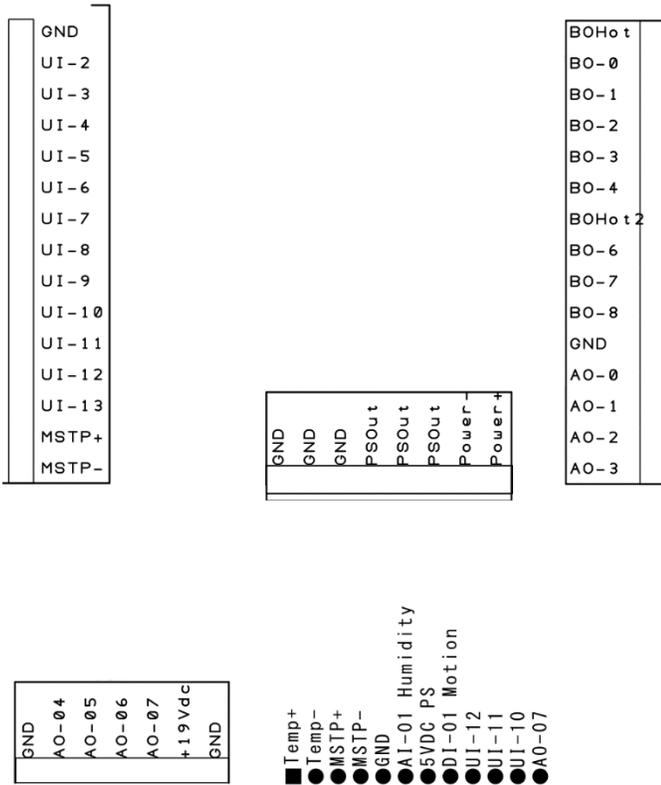


Fig. 4

*Note: Thermostat Common Relay point (BO Hot) usually 24VAC/DC or R

*Note: AI-2 through AI-5 and BI-2 through BI-5 are wired to UI-2 through UI-5. Each universal Input can only be used as an AI or a BI

GND Neutral/Ground
 UI-2..... Universal Input 2
 UI-3..... Universal Input 3
 UI-4..... Universal Input 4
 UI-5..... Universal Input 5
 UI-6..... Universal Input 6
 UI-7..... Universal Input 7
 UI-8..... Universal Input 8
 UI-9..... Universal Input 9
 UI-10 Universal Input 10
 UI-11 Universal Input 11
 UI-12 Universal Input 12
 UI-13 Universal Input 13
 MSTP + Network Line Positive
 MSTP - Network Line Negative

BO Hot 24VAC/DC Input for Relays 1-5*
 BO-0..... Relay 1 Output, 24VAC/DC
 BO-1 Relay 2 Output, 24VAC/DC
 BO-2..... Relay 3 Output, 24VAC/DC
 BO-3..... Relay 4 Output, 24VAC/DC
 BO-4..... Relay 5 Output, 24VAC/DC
 BO Hot 2 24VAC/DC Input for Relays 7-9*
 BO-6..... Relay 7 Output, 24VAC/DC
 BO-7 Relay 8 Output, 24VAC/DC
 BO-8..... Relay 9 Output, 24VAC/DC
 GND Neutral/Ground
 AO-0..... Analog Output 0, 0-10V
 AO-1 Analog Output 1, 0-10V
 AO-2..... Analog Output 2, 0-10V
 AO-3..... Analog Output 3, 0-10V

GND Neutral/Ground
 GND Neutral/Ground
 GND Neutral/Ground
 PSOut..... 24VAC/DC Hot
 PSOut..... 24VAC/DC Hot
 PSOut..... 24VAC/DC Hot
 Power - Neutral/Ground
 Power + 24VAC/DC Hot

GND Neutral/Ground
 AO-04 Analog Output 4, 0-10V
 AO-05 Analog Output 5, 0-10V
 AO-06 Analog Output 6, 0-10V
 AO-07 Analog Output 7, 0-10V
 +19Vdc 19V DC
 GND Neutral/Ground

Output Wiring

Output/Label	Heat / Cool Mode
BO0	Fan
BO1	Cooling Stage 1
BO2	Heating Stage 1
BO3	Cooling Stage 2
BO4	Lighting Command
AO0	Damper Command
AO1	

Reserved BACnet Points

The following are points reserved by the thermostat for operation.

Analog Inputs

Instance	Object Name	Description	Read/Write	Default
AI-0	Room Temp	Reading of the internal thermistor in counts. 0-1024	R	variable
AI-1	Humidity	Reading from the Humidity sensor add-on card	R	variable
AI-2	Ext. Room Temp	Optional external room temperature input	R	variable
AI-3	Analog Input 03	Reading of the external input 3 in counts. 0-1024	R	variable
AI-4	Analog Input 04	Reading of the external input 4 in counts. 0-1024	R	variable
AI-5	Analog Input 05	Reading of the external input 5 in counts. 0-1024	R	variable

Analog Outputs

Instance	Object Name	Description	Read/Write	Default
AO-0	Damper Command	0-10V output for control of Damper	R/W	0.0
AO-1	Analog Output 1	Variable 0-14VDC, 150mA output	R/W	0.0
AO-2	Analog Output 2	Variable 0-14VDC, 150mA output	R/W	0.0

Analog Values

Instance	Object Name	Description	Read/Write	Default
AV-0	Mode of Operation	The mode that the thermostat is currently in. 0 = Heat Mode 1 = Cool Mode 2 = Idle 3 = Afterhours 4 = Unoccupied Idle 5 = Unoccupied Heat Mode 6 = Unoccupied Cool Mode	R	4
AV-1	RTU Heating Signal	Current heating signal	R	0
AV-2	RTU Cooling Signal	Current cooling signal	R	0
AV-3	Analog Value 003			
AV-4	Current Htg SP	The setpoint that controls heating. If the room temperature goes below this setpoint the thermostat will enter heating mode.	R	60.0°F
AV-5	Current Clg SP	The setpoint that controls cooling. If the room temperature goes above this setpoint the thermostat will enter cooling mode.	R	80.0°F
AV-6	Occupied Heating SP	The setpoint used for heating during occupied mode. This setpoint is calculated by AV-66 (Current SP) – AV-70 (Heating Offset)	R	72.0°F
AV-7	Occupied Cooling SP	The setpoint used for cooling during occupied mode. This setpoint is calculated by AV-66 (Current SP) + AV-69 (Cooling Offset)	R	74.0°F
AV-8	Damper Heating Signal	Current heating command for the damper	R	0
AV-9	Damper Cooling Signal	Current cooling command for the damper		
AV-10	Network Temperature	Temperature used for control that is written from a different network device	R/W	0°F
AV-11	Analog Value 011			
AV-12	Analog Value 012			
AV-13	Analog Value 013			
AV-14	Analog Value 014			
AV-15	Analog Value 015			
AV-16	Analog Value 016			
AV-17	Hi Sensor Temperature	The highest temperature determined from AI-0 and AI-2 or AV-10. Use BV-56 to select between AI-2 and AV-10.	R	variable
AV-18	Lo Sensor Temperature	The lowest temperature determined from AI-0 and AI-2 or AV-10. Use BV-56 to select between AI-2 and AV-10.	R	variable
AV-19	Average Temperature	The average temperature calculated using AI-0 and AI-2 through AI-5. Use AV-36 to configure the number of external sensors used in the average.	R	variable
AV-20	Room Temp	The temperature used for the control sequence. This is the value displayed on the LCD of the thermostat and should be used to display the temperature on any workstation display.	R	variable

AV-21	Analog Value 021			
AV-22	FTR Valve % Open	Current position of the radiation valve	R	0%
AV-23	Valve Cycle Divisor	Multiplied with the valve position to determine the time the valve command is ON or OFF. (Value is AV-41/100)	R	0.1
AV-24	Valve ON Time	The amount of time to keep the valve output ON.	R	0 sec
AV-25	Valve OFF Time	The amount of time to keep the valve output OFF.	R	0 sec
AV-26	Cooling Deviation	Number of degrees that the room temperature is away from the cooling set point	R	variable
AV-27	Heating Deviation	Number of degrees that the room temperature is away from the heating set point	R	variable
AV-28	Deviation from SP	Number of degrees that the room temperature is away from the room set point	R	variable
AV-29	Zone Scan	Numerical representation of the thermostats mode. 100 = full heat, -100 = full cool	R	0
AV-30	AI-0 Setup	Parameter used to set the input type. 0 = counts 1 = temperature 2 = 4-20mA 3 = 0-5V 4 = 0-10V 5 = pulse	R	1
AV-31	AI-1 Setup	See AV-30	R	0
AV-32	AI-2 Setup	See AV-30	R	0
AV-33	AI-3 Setup	See AV-30	R	0
AV-34	AI-4 Setup	See AV-30	R	0
AV-35	AI-5 Setup	See AV-30	R	0
AV-36	Lighting On Delay	Time in seconds that will leave BO-4 on when BI-4 is turn inactive after it has been active.	R/W	0
AV-37	Cooling Stage 1 Runtime	Cooling stage 1 Runtime in hours	R/W	0
AV-38	Cooling Stage 2 Runtime	Cooling stage 2 Runtime in hours	R/W	0
AV-39	Heating Stage 1 Runtime	Heating stage 2 Runtime in hours	R/W	0
AV-40	Heat/Cool Command	Used to control heating and cooling. With a range of -100 to 100. -100 is a request for full cooling. 100 is a request for full heating.	R/W	0
AV-41	Analog Value 041			
AV-42	Analog Value 042			
AV-43	Analog Value 043		R/W	120 sec
AV-44	DAT High Limit	Limit of the discharge temperature. Will turn off the heat signal when the discharge is meet..	R/W	120°F
AV-45	Analog Value 045			
AV-46	Analog Value 046			
AV-47	Analog Value 047			
AV-48	Analog Value 048			
AV-49	Analog Value 049			
AV-50	Damper Heat Max	The max position the damper would move during heating mode.	R/W	100%
AV-51	Damper Heat Min	The Minimum position the damper would move during heating mode.	R/W	0%

AV-52	Damper Cool Max	The max position the damper would move during cooling mode.	R/W	100%
AV-53	Damper Cool Min	The Minimum position the damper would move during cooling mode..	R/W	0%
AV-54		Used in Hotel Mode, for occupancy detection. This delay is used to eliminate false sensor readings.	R/W	0.1 sec
AV-55	Occupied DOB Delay	Used in Hotel Mode, for occupancy detection. This delay is used to hold the room occupied for 15 minutes after it has been determined that the tenant has left to room.	R/W	900 sec
AV-56	Analog Value 056			
AV-57	Analog Value 057			
AV-58	Reserved	This point is reserved for internal thermostat use and its value cannot be changed	R	1.6
AV-59	Ave Time Base	Factor used to average the room temperature. A small number will allow the room temperature to change faster over time. A large number will cause the room temperature to change slower over time.	R	100
AV-60	Calibration Offset	The calibration offset for the internal thermistor.	R	variable
AV-61	Space Alarm Offset	This offset +/- the Current Cooling/Heating SP is used to determine if the space is too warm/cold, and set an alarm if necessary.	R/W	5.0°F
AV-62	# of Fan Speeds	Select the number of fan speeds for a multispeed fan. 0 = Auto Only 1 = AUTO - ON 2 = Off - AUTO - ON 3 = Off-1-2-AUTO 4 = Off-1-2-3-AUTO	R/W	0
AV-63	Current Fan Speed	The fan speed the thermostat is currently running. 0 = OFF 1 = Fan Speed 1 2 = Fan Speed 2 3 = Fan Speed 3 4 = AUTO 5 = ON	R	4
AV-64	Vacant Clg SP	Used in Hotel Mode. When a room is known vacant, the setpoint can be set below the unoccupied setpoint.	R/W	85.0°F
AV-65	Vacant Htg SP	Used in Hotel Mode. When a room is known vacant, the setpoint can be set below the unoccupied setpoint.	R/W	65.0°F
AV-66	Room Setpoint	The occupied room setpoint	R/W	73.0°F
AV-67	Occupied SP Hi Limit	The maximum occupied room setpoint allowed.	R/W	85.0°F
AV-68	Occupied SP Lo Limit	The minimum occupied room setpoint allowed	R/W	55.0°F
AV-69	Clg Offset	The offset from Room Setpoint used to calculate the Occupied Cooling SP	R/W	1.0°F
AV-70	Htg Offset	The offset from Room Setpoint used to calculate the Occupied Heating SP	R/W	1.0°F
AV-71	Unoccupied Clg SP	The cooling setpoint used when the thermostat is unoccupied.	R/W	80.0°F

AV-72	Unoccupied Htg SP	The heating setpoint used when the thermostat is unoccupied.	R/W	60.0°F
AV-73	After Hours Limit	The maximum hours the thermostat is allowed to run during afterhours time. Setting this will set the thermostat to occupied operation. (0-99.9 hrs)	R/W	5.0 hrs
AV-74	After Hours Timer	The current amount of afterhours time left.	R	0.0 hrs
AV-75	Reserved	This point is reserved for internal thermostat use and its value cannot be changed	R	0
AV-76	Reserved	This point is reserved for internal thermostat use and its value cannot be changed	R	0
AV-77	Reserved	This point is reserved for internal thermostat use and its value cannot be changed	R	0
AV-78	Reserved	This point is reserved for internal thermostat use and its value cannot be changed	R	0
AV-79	Reserved	This point is reserved for internal thermostat use and its value cannot be changed	R	0
AV-80	Reserved	This point is reserved for internal thermostat use and its value cannot be changed	R	0
AV-81	Motion OFF Delay	The amount of time to delay the ON->OFF transition of the motion sensor occupied command after no motion is detected	R/W	900 sec
AV-82	Analog Value 082			
AV-83	Analog Value 083			
AV-84	Analog Value 084			
AV-100	Analog Value 100	Internal thermistor display descriptor. The present value is automatically transferred. The AV description holds the descriptor to display.	R	variable
AV-101	Analog Value 101	Display descriptor. Transfer the value to display to the present value. The AV description holds the descriptor to display.	R/W	
AV-102	Analog Value 102	Display descriptor. Transfer the value to display to the present value. The AV description holds the descriptor to display	R/W	
AV-103	Analog Value 103	Display descriptor. Transfer the value to display to the present value. The AV description holds the descriptor to display	R/W	
AV-104	Analog Value 104	Display descriptor. Transfer the value to display to the present value. The AV description holds the descriptor to display	R/W	
AV-105	Analog Value 105	Display descriptor. Transfer the value to display to the present value. The AV description holds the descriptor to display	R/W	
AV-106	Analog Value 106	Display descriptor. Transfer the value to display to the present value. The AV description holds the descriptor to display	R/W	
AV-107	Analog Value 107	Display descriptor. Transfer the value to display to the present value. The AV description holds the descriptor to display	R/W	

AV-108	Analog Value 108	Display descriptor. Transfer the value to display to the present value. The AV description holds the descriptor to display	R/W	
AV-109	Analog Value 109	Display descriptor. Transfer the value to display to the present value. The AV description holds the descriptor to display	R/W	
AV-110	Analog Value 110	Display descriptor. Transfer the value to display to the present value. The AV description holds the descriptor to display	R/W	
AV-111	Analog Value 111	Internal humidity display descriptor. Transfer the value to display to the present value. The AV description holds the descriptor to display	R/W	
AV-112	Analog Value 112	Outside Air Display descriptor. Transfer the value to display to the present value. The AV description holds the descriptor to display	R/W	

Binary Inputs

Instance	Object Name	Description	Read/Write	Default
BI-0	Binary Input 00		R	
BI-1	Motion	Motion sensor status from the add-on card	R	
BI-2	Binary Input 02		R	
BI-3	Hotel Room Sensor	Occupancy Sensor located on the room space	R	
BI-4	Hotel Door Sensor	Occupancy sensor located by the room door	R	
BI-5	Opt. Occupied Relay	Optional occupancy relay input	R	

Binary Outputs

Instance	Object Name	Description	Read/Write	Default
BO-0	Fan	Output for Fan Control	R/W	OFF
BO-1	Compressor/Clg	Output for Compressor in Comp/Rev Mode. Output for Cooling Stage 1 in Htg/Clg Mode.	R/W	OFF
BO-2	Rev. Valve/Htg	Output for Reversing Valve when in Comp/Rev Mode. Output for Heating Stage 1 when in Htg/Clg Mode.	R/W	OFF
BO-3	Clg Stage 2	Output for Cooling Stage 2	R/W	OFF
BO-4	Htg Stage 2/FTR	Output for Heating Stage 2 or Radiation	R/W	OFF
BO-5	Scheduled Occupied	Logical point only. Used for scheduling purposes. INACTIVE is unoccupied.	R/W	OFF

Binary Values

Instance	Object Name	Description	Read/Write	Default
BV-0	Bad Sensor Alarm	Alarm for a bad internal thermistor	R	OFF
BV-1	H/C Mode	Sequence point to show analog heating or cooling. OFF = Cooling ON = Heat	R	OFF
BV-2	Binary Value 002			
BV-3	Binary Value 003			
BV-4	Binary Value 004			
BV-5	Heat Enabled	Heating is allowed by system by BV-38	R	ON
BV-6	Binary Value 006			
BV-7	Binary Value 007			
BV-8	Binary Value 008			
BV-9	Space Alarm Delay	Delay used to prevent a space alarm after receiving an occupied command. The delay is 7200 sec	R	OFF
BV-10	Program Status	Used to determine if the sequence was loaded correctly on a BACnet Restore or power up.	R	OFF
BV-11	Binary Value 011			
BV-12	FTR ON Cmd	Status of the Valve ON command	R	OFF
BV-13	FTR OFF Cmd	Status of the Valve OFF command	R	OFF
BV-14	FTR Command	Radiation Valve command	R	OFF
BV-15	Binary Value 015			

BV-16	Htg Stage 1 Request	Stage 1 heat is requested. The sequence determines if this is a Htg/Clg request or a Comp/Rev request	R	OFF
BV-17	Clg Stage 1 Request	Stage 1 cool is requested. The sequence determines if this is a Htg/Clg request or a Comp/Rev request	R	OFF
BV-18	Htg Stage 2 Request	Stage 2 heat is requested. If radiation is not enabled (BV-50) BO-4 will be commanded.	R	OFF
BV-19	Binary Value 019			
BV-20	Fan Request - Heat	Used to request the fan to run when using the analog heat signal, AO-0, for control. Must be enabled by BV-52.	R	OFF
BV-21	Fan Request – Cool	Used to request the fan to run when using the analog cool signal, AO-1, for control. Must be enabled by BV-53.	R	OFF
BV-22	Too Warm Status	Status of the Too Warm Alarm before checking the Space Alarm Delay	R	OFF
BV-23	Too Cool Status	Status of the Too Cool Alarm before checking the Space Alarm Delay	R	OFF
BV-24	Space To Warm Alarm	The space temperature has been below the Room Set point (AV-66) – Space Alarm Offset (AV-61) for at least 7200 seconds.	R	OFF
BV-25	Space To Cool Alarm	The space temperature has been above the Room Set point (AV-66) + Space Alarm Offset (AV-61) for at least 7200 seconds.	R	OFF
BV-26	Heat Stage 1 Status	The status of the stage 1 heat request before the 180 second anti-short cycle delay.	R	OFF
BV-27	Cool Stage 1 Status	The status of the stage 1 cool request before the 180 second anti-short cycle delay.	R	OFF
BV-28	Heat Stage 2 Status	The status of the stage 2 heat request before the 180 second anti-short cycle delay.	R	OFF
BV-29	Cool Stage 2 Status	The status of the stage 2 cool request before the 180 second anti-short cycle delay.	R	OFF
BV-30	Hotel Mode Seq 100	Used in the Hotel Mode only. This is a debug point.	R	OFF
BV-31	Hotel Mode Seq 110	Used in the Hotel Mode only. This is a debug point.	R	OFF
BV-32	Hotel Mode Seq 120	Used in the Hotel Mode only. This is a debug point.	R	OFF
BV-33	Hotel Mode Seq 130	Used in the Hotel Mode only. This is a debug point.	R	OFF
BV-34	Hotel Mode Seq 140	Used in the Hotel Mode only. This is a debug point.	R	OFF
BV-35	Hotel Mode Seq 150	Used in the Hotel Mode only. This is a debug point.	R	OFF
BV-36	Binary Value 036			
BV-37	Binary Value 037			
BV-38	Heating Lockout	System has heating locked out	R/W	OFF
BV-39	Binary Value 039			
BV-40	Occupied Status	The status of this point switches the thermostats occupancy settings. When ON, the thermostat is in Occupied Setpoint Mode or After Hours Mode.	R	OFF

BV-41	Opt. Start Warmup	A Warmup command has been sent to the thermostat. When ON the thermostat will switch to occupied settings.	R/W	OFF
BV-42	Opt. Start Cooldown	A Cooldown command has been sent to the thermostat. When ON the thermostat will switch to occupied settings.	R/W	OFF
BV-43	Occ Set point Mode	The thermostat has been commanded occupied via BO-5, or a Warmup/Cooldown command has been sent via BV-41/BV-42.	R	OFF
BV-44	After Hours Status	The thermostat has been set to afterhours mode. When ON the thermostat will switch to occupied settings.	R	OFF
BV-45	Reserved	This point is reserved for internal thermostat use and its value cannot be changed	R	OFF
BV-46	Binary Value 046			
BV-47	Binary Value 047			
BV-48	FTR Valve Request	Valve Open/Close request	R	OFF
BV-49	Update Descriptors	When ON descriptor changes are sent to the thermostats LCD, this point will auto reset to OFF.	R/W	OFF
BV-50	FTR Output Enable	Enables option feature, PWM Valve Modulation, in control sequence, hardware changes are required for this feature to work.	R/W	OFF
BV-51	BI for Occupancy	ON = BI-5 will be used to indicate occupancy OFF = BI-5 is not used for occupancy	R/W	OFF
BV-52	Enable Analog Heat Fan Request	Allow the analog heat signal to request the fan to start	R/W	OFF
BV-53	Enable Analog Heat Fan Request	Allow the analog cool signal to request the fan to start	R/W	OFF
BV-54	Heating Signal Reverse	Reserves the heating analog output AO-0, from 0-10V to 10-0V.	R/W	OFF
BV-55	Cooling Signal Reverse	Reserves the cooling analog output AO-1, from 0-10V to 10-0V	R/W	OFF
BV-56	Ext Temp Local/Remote	OFF = External Temperature is from AI-2 ON = External Temperature is from AV-10	R/W	OFF
BV-57	Disable Splash	When ACTIVE, the "EXACTLOGIC" splash will not show after key presses	R/W	OFF
BV-58	Disable Setup Menu	When ACTIVE, there will be no access to the Setup Menu where the Network/MAC/Baud Rate is set	R/W	OFF
BV-59	Disable FSM Menu	When ACTIVE, there will be not access to the Field Service Mode where the Time/Schedule/Point Access is set	R/W	OFF
BV-60	Hi/Lo Select Mode	ON = Select the Network Temp, AV-10, for Hi/Lo Mode OFF = Select the External Sensor, AI-2, for HI/Lo Mode	R/W	OFF
BV-61	Temperature Select Mode 1	ON = Select the Average Temp, AV-19, for control OFF = Select the Hi/Lo Mode for control	R/W	OFF
BV-62	Temperature Select Mode 2	ON = Select Average or Hi/Lo Mode OFF = Select Network Temp for control	R/W	OFF

BV-63	Temperature Select Mode 3	ON = Select Average, Hi/Lo, or Average Mode OFF = Selects Internal (AI-0) or External Temp (AI-2) for control	R/W	OFF
BV-64	Enable Motion	When ACTIVE, the power to the Motion add-on card is set to the proper voltage	R/W	OFF
BV-65	Binary Value 065			
BV-66	Disable Unit	When ON this point will disable and lockout all analog and binary outputs.	R/W	OFF
BV-67	Room Temp Select	ON = Select the external thermistor, AI-2, for the control sequence OFF = Select the internal thermistor, AI-0, for the control sequence.	R/W	OFF
BV-68	Backlight Off/On	When ON the LCD backlight will remain on	R/W	OFF
BV-69	Fan Op Mode	Controls if the fan will cycle or run continuously. OFF = Cycle, ON = Continuous, BV-40 must also be ON.	R/W	OFF
BV-70	Room Vacant Status	When ON the thermostat will run on Vacant Heating/Cooling setpoints, AV-64/AV-65.	R/W	OFF
BV-71	C/F	Sets the thermostat to display temperatures in Celsius or Fahrenheit. This point is set through the setup menu. ON = F, OFF = C	R	ON
BV-72	HP Type	OFF = Compressor/Reversing Valve Mode ON = Heat/Cool Mode	R/W	ON
BV-73	Rev Valve	Set which mode to turn on the reversing value. OFF = Heat, ON = Cool	R/W	OFF
BV-74	Hotel Mode	Determines how the thermostats occupancy is set. OFF = Normal Mode, ie schedule ON = Hotel Mode, ie motion sensors	R/W	OFF
BV-100	Binary Value 100	Enable internal thermistor descriptor	R/W	ON
BV-101	Binary Value 101	Enable descriptor	R/W	OFF
BV-102	Binary Value 102	Enable descriptor	R/W	OFF
BV-103	Binary Value 103	Enable descriptor	R/W	OFF
BV-104	Binary Value 104	Enable descriptor	R/W	OFF
BV-105	Binary Value 105	Enable descriptor	R/W	OFF
BV-106	Binary Value 106	Enable descriptor	R/W	OFF
BV-107	Binary Value 107	Enable descriptor	R/W	OFF
BV-108	Binary Value 108	Enable descriptor	R/W	OFF
BV-109	Binary Value 109	Enable descriptor	R/W	OFF
BV-110	Binary Value 110	Enable descriptor	R/W	OFF
BV-111	Binary Value 111	Enable internal humidity descriptor	R/W	OFF
BV-112	Binary Value 112	Enable outside air descriptor	R/W	OFF