

ExactLogic BACnet Communicating Thermostat



BACnet is a registered trademark of ASHRAE. ASHRAE does not endorse, approve or test products for compliance with ASHRAE standards. Compliance of listed products to requirements of ASHRAE Standard 135 is the responsibility of the BACnet International. BTL is a registered trademark of the BACnet International.



DataSheet Rev 1.20.002
May 19, 2025

Initial Setup

A thermostat is initially configured with the following setup:

MS/TP Network: 99
MS/TP MAC Address: 99
Baud Rate: 76.8 Kbps
Celsius/Fahrenheit: Fahrenheit

Setup

To change the setup of the thermostat, the menu must be accessed via the keypad buttons. By holding down the bottom two buttons together for 5 seconds, the display will change and ask for a password (Fig. 5). The password to access the menu is:

- Second from the bottom right (twice)
- Second from the bottom left
- Bottom left

As each key is pressed, an "X" will show on the display. If the password is incorrect the display will show a message and exit the menu (Fig 6). Successfully entering the password will switch the display to the first menu item. To scroll through the menu, use the bottom left of buttons. To change the setting, press the two bottom right buttons. Pressing one of the lower right pair of buttons once will select the item to be changed. To change the value, a second key press is required.

To make faster adjustments holding the [down] key for 1 second (sets the down increment to 15) or 3 seconds (sets the down increment to 30) subsequently pressing the [down] key will subtract 15 or 30 for each press. If you then press the up key, it will set the down increment back to 1.

This also works for the [up] key.

Setup Menu

MSTP Net:

Set the MS/TP Network number to be equal to the thousands value of your device instance. NNNN000

-Where "NNNN" is the network number.

C or F:

Choose Celsius or Fahrenheit

CommStat:

CommStat shows the number of successful receptions of the token, when connected to a network.

BaudRate:

Choose the Baud rate of your network. (76.8, 38.4, 19.2, 9.6)

SW REV:

Software Revision

Model:

Model number of the stat

MSTP MAC:

Set the MS/TP MAC address to be equal to the hundredths value of your device instance. 0000MMM

-Where "MMM" is the MAC address.

As an example, to execute an adjustment from MAC = 99 to a MAC = 2 do the following:

- Enter the setup mode
- Select the MAC address setting
- Press and hold the [down] key for 3 seconds then release
- MAC address will change to 098
- Press and release the [down] key
- MAC = 068
- Press and release the [down] key
- MAC = 038
- Press and release the [down] key
- MAC = 008
- Press and release the [up] key (sets the down increment to 1)
- MAC = 009
- Press and release the [down] key 7 times
- MAC = 002

Once all changes have been made, the keypad waits for 5 seconds without a key press, and then the thermostat will reset itself. If no changes are made, the top pair of buttons (middle pair for 6 button setup) was not pressed, the thermostat will timeout with 5 seconds without a key press and return to showing the room temperature.

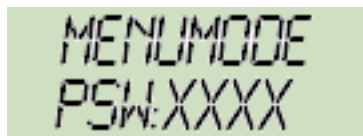


Fig. 5

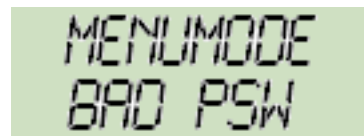


Fig. 6

Field Service Mode

Field Service Mode is used to set commonly used setpoints, set the system date and time and set the standalone occupancy schedule when a BACnet system is not available.

How to Enter the Field Service Setup

To enter Field Service Mode, hold down the two bottom left buttons for 5 seconds. The display will change and ask for a password (Fig. 5).

The keypad password to access the menu is:

- Second from the bottom left
- Bottom right
- Second from the bottom right
- Bottom left.

As each key is pressed, an "X" will show on the display. If the password is incorrect the display will show a message and exit the menu (Fig 6).

Successfully entering the password will switch the display to the first menu item. To scroll through the menu, use the two bottom left buttons. To change the setting, press one of the two bottom right buttons. Pressing one of the right buttons once will select the item to be changed. To change the value, a second key press is required.

Note: There is a 5 second keypad inactivity timeout. After the 5 seconds the main Field Service Menu will start. If another 5 seconds elapses without a key press, the thermostat will return to normal operation and display the room temperature.



Fig. 5

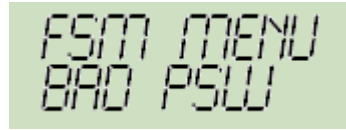


Fig. 6

Field Service Menu

- Set Time:
Set your time.
- Change SP:
This menu allows you to modify any setpoints within the controller.
- Set Sched:
Allows you to set schedules and/or create events.

ChangeSP Menu

The Change Setpoint menu allows you to change commonly used setpoints and configuration settings. Setpoints available for modification are as follows:

Fan Speed:

Available Fan Speed Options:
0 = Auto Only (Default setting)
1 = AUTO - ON
2 = Off - AUTO - ON
3 = Off-1-2-AUTO
4 = Off-1-2-3-AUTO

Bypass Occ:

Allows you to override the occupied schedule.

SP Inc/Dec:

Allows you to adjust your setpoint.

Ext RmTemp:

Optional external room sensor.

Occupied:

Sets Day and Night mode.

ClgEnable:

Enables cooling to operate.

HtgEnable:

Enables heating to operate.

- AftHrLimit:
Adjust afterhours maximum.
- UnoccHtgSP:
Sets the unoccupied heating setpoint.
- UnoccClgSP:
Sets the unoccupied cooling setpoint.
- Htg Offset:
Sets the heating offset, the default is 1.
- Clg Offset:
Sets the cooling offset, the default is 1.
- Occ LoLimit:
Limits the occupied setpoint.
- Occ HiLimit:
Limits the occupied setpoint.

Set Time Menu

The System Time Menu allows you to change the Hour, Minute, Year, Month, and Day.

- Use the Left pair of buttons to cycle through these settings
- Use the right pair of buttons to change the value of each setting.
- Pressing one of the right buttons once will select the item to be changed.

To change the value, a second key press is required.

Set Schedule Menu (Set Schd)

The thermostat is equipped with a 7-day 4 event internal schedule. There are 2 occupied events and 2 unoccupied events for each day. Every day must have at least one event. If no event is set, an unoccupied event at 12:00 AM (midnight) will automatically be set.

Events 1 and 3 are occupied events and Events 2 and 4 are unoccupied events.

The right pair of keys will navigate through the events.

A cursor will move from hours to minutes on each event to show which field is selected for modification.

If no number is selected for the hours and minutes, then this event is blank and will not be used by the schedule. The hours are on a 12-hour time. I.e. 11:00 AM will roll over to 12:00 PM and 11:00PM will roll over to 12:00AM

The following examples show how to set the schedule for different times.

Occupied on Monday from 6AM to 6PM

Mon Evt1: 06:00 AM
Mon Evt2: 06:00 PM
Mon Evt3: blank
Mon Evt4: blank

Occupied on Monday from 6PM to Tuesday 6AM

Mon Evt1: 06:00 PM
Mon Evt2: blank
Mon Evt3: blank
Mon Evt4: blank
Tue Evt1: blank
Tue Evt2: 06:00 AM
Tue Evt3: blank
Tue Evt4: blank

Occupied on Monday from 6AM to 6PM and 10PM to Tuesday 6AM

Mon Evt1: 06:00 AM
Mon Evt2: 06:00PM
Mon Evt3: 10:00 PM
Mon Evt4: blank
Tue Evt1: blank
Tue Evt2: 06:00 AM
Tue Evt3: blank
Tue Evt4: blank

Once the schedule is set, the keypad waits for 5 seconds without a key press. After the 5 seconds, an option will display asking if the schedule should be enabled. Selecting "Y" will make the schedule active, selecting "N" will copy the schedule to internal memory but will not activate the schedule for use. If another 5 seconds elapses without a key press the thermostat will return to normal operation and display the room temperature.

Display Descriptors

The display descriptors are used to display custom information such as input/output status or sensor values. Descriptor text is entered in the description field of AV-100 through AV-112. The value to display is entered into the present value field of the AV. The descriptors are enabled by BV-100 through BV-112.

Use the following format when entering Descriptors: XXXXXXXX,,YZ

Descriptor Text

The Descriptor Text, depicted with the X's above, will be shown on the top line of the thermostats LCD. Each line consists of 8 letters, numbers or symbols. Letters can be upper or lower case and spaces can be used to center the text if it is less than 8 characters.

Descriptor Value

The Descriptor Value, depicted by the Y and Z above, will be shown on the bottom line of the thermostats LCD. The Descriptor Text and Value must be separated by two (2) commas to display correctly.

Use the following information to set the Descriptor Value to display the desired value.

Display a Blank Line

To have the bottom-line blank use $Z = 0$. The value of Y is ignored.

Display a Number

To display a number use $Z = 1$.

The value of Y will display the units for the number being displayed.

$Y = 0$ will display percentage (%)

$Y = 1$ will show temperature, the unit ($^{\circ}\text{C}/^{\circ}\text{F}$) is based on the value of BV-71

$Y = 3$ will show Amperes (A)

Any other values of Y will have no units shown.

Displaying a Digital Value

To display a digital status use $Z = 2$. The value shown will be either 'Inactive' or 'Active' based on the present value of the AV.

Display BTUs

To display a number in BTUs use $Z = 3$.

The value of Y will display the units for the number being displayed.

$Y = 0$ will display 'M' for 1,000's of BTUs (MBH)

$Y = 1$ will display "MM" for 1,000,000's of BTUs (MMBTU)

Display Air Flow

To display a number in air flow units use $Z = 4$.

The value of Y will display the units for the number being displayed.

$Y = 4$ will display feet per minute (fpm)

$Y = 5$ will display cubic feet per minute (cfm)

In order to update the descriptor changes you must turn BV-49 ACTIVE. This point will auto reset itself.

Input/Output Setup

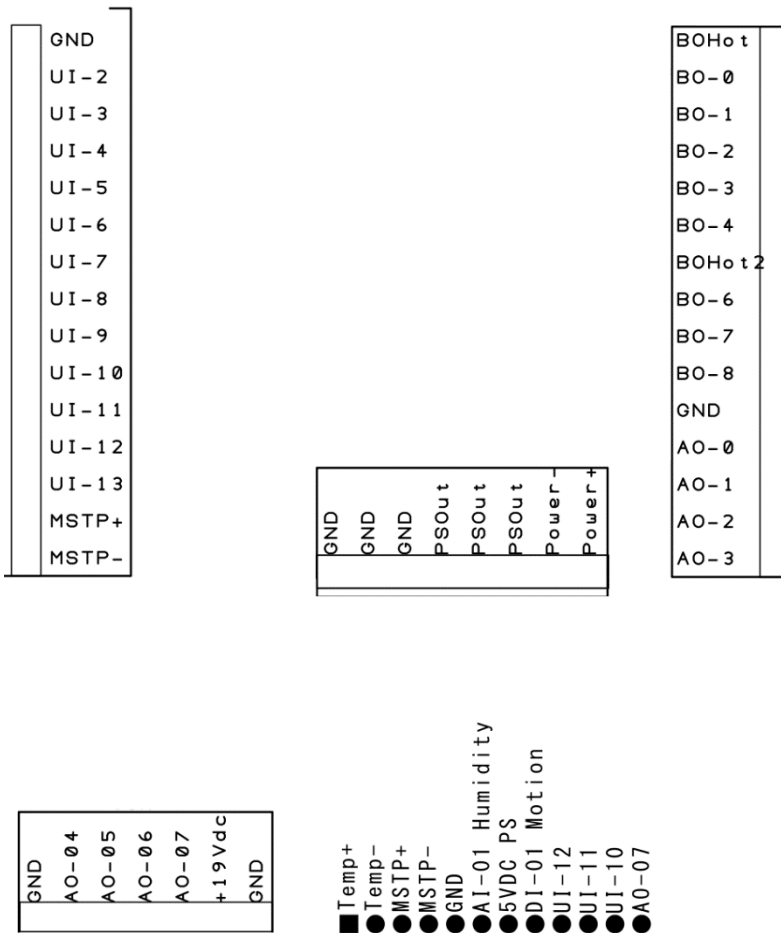


Fig. 1

*Note: BO Hot usually 24VAC/DC input for Relays or R

**** Always connect the AC 24V wire last and make sure your power supply ground is connected with a single wire and no wire nuts disconnecting the common wire will damage the controller.**

GND Neutral/Ground
UI-2..... Universal Input 2
UI-3..... Universal Input 3
UI-4..... Universal Input 4
UI-5..... Universal Input 5
UI-6..... Universal Input 6
UI-7..... Universal Input 7
UI-8..... Universal Input 8
UI-9..... Universal Input 9
UI-10 Universal Input 10
UI-11 Universal Input 11
UI-12 Universal Input 12
GND GND
MSTP + Network Line Positive
MSTP - Network Line Negative

BO Hot 24VAC/DC Input for Relays 1-5*
BO-0 Relay 1 Output, 24VAC/DC
BO-1 Relay 2 Output, 24VAC/DC
BO-2 Relay 3 Output, 24VAC/DC
BO-3 Relay 4 Output, 24VAC/DC
BO-4 Relay 5 Output, 24VAC/DC
BO Hot 2 24VAC/DC Input for Relays 7-9*
BO-6 Relay 7 Output, 24VAC/DC
BO-7 Relay 8 Output, 24VAC/DC
BO-8 Relay 9 Output, 24VAC/DC
GND Neutral/Ground
AO-0 Analog Output 0, 0-10V
AO-1 Analog Output 1, 0-10V
AO-2 Analog Output 2, 0-10V
AO-3 Analog Output 3, 0-10V

GND Neutral/Ground
GND Neutral/Ground
GND Neutral/Ground
PSOut..... 24VAC/DC Hot
PSOut..... 24VAC/DC Hot
PSOut..... 24VAC/DC Hot
Power - Neutral/Ground
Power + 24VAC/DC Hot

GND Neutral/Ground
AO-04 Analog Output 4, 0-10V
AO-05 Analog Output 5, 0-10V
AO-06 Analog Output 6, 0-10V
AO-07 Analog Output 7, 0-10V
+19Vdc 19V DC
GND Neutral/Ground

Universal Input Setup

The universal inputs are configured using the two 12-position DIP switches located in the top left corner of the thermostat, and a software setting at AV-30 through AV-35.

The DIP switch is used to configure UI-1 through UI-12. UI-0 is hardware configured to a dry contact/thermistor type input. UI-13 is hardware configured to a pulse only. Each input uses two switches to set the input type. See figure 2 below for the switches used for each input.

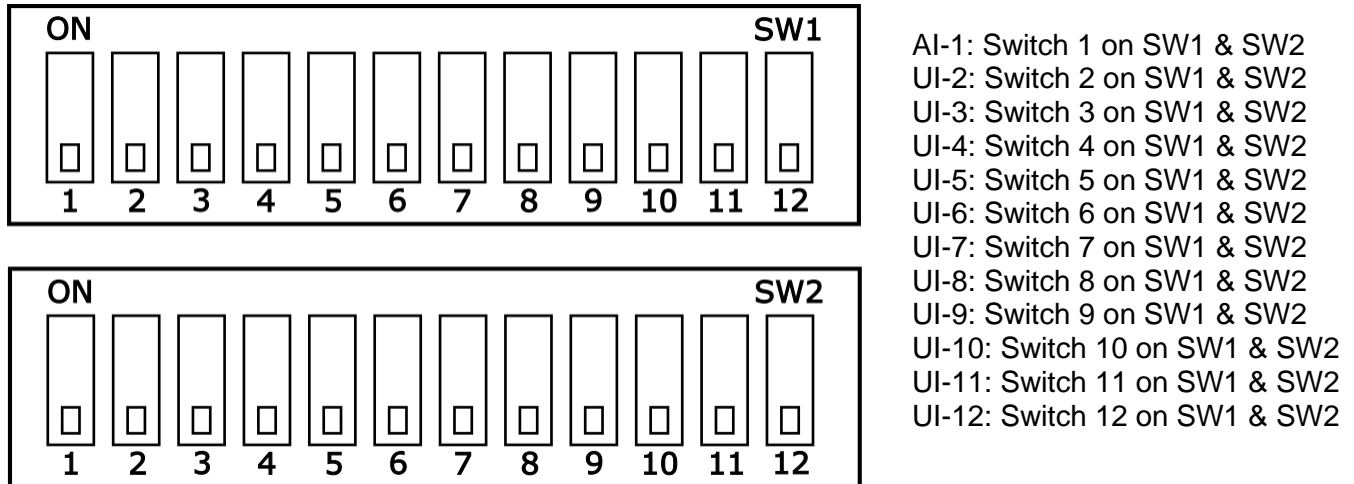


Fig. 2


The universal inputs can be set up to read a dry contact, thermistor, 4-20mA, 0-5V, 0-10V, or pulse sensor. AV-30 through AV-35 are used to configure the input type for each universal input. Below is a list of the possible settings. AV-30 through 35 corresponds to AI-0 through AI-5.

AV-30	AI-0	0 = counts
AV-31	AI-1	1 = thermistor
AV-32	AI-2	2 = 4-20mA
AV-33	AI-3	3 = 0-5V
AV-34	AI-4	4 = 0-10V
AV-35	AI-5	5 = Pulse

Analog Inputs

Dry Contact/External Thermistor

If there is a dry contact or external thermistor used, set switch for the respective input, see figure 3*. Sensor values will be sent to the present-value property of the Analog Input.

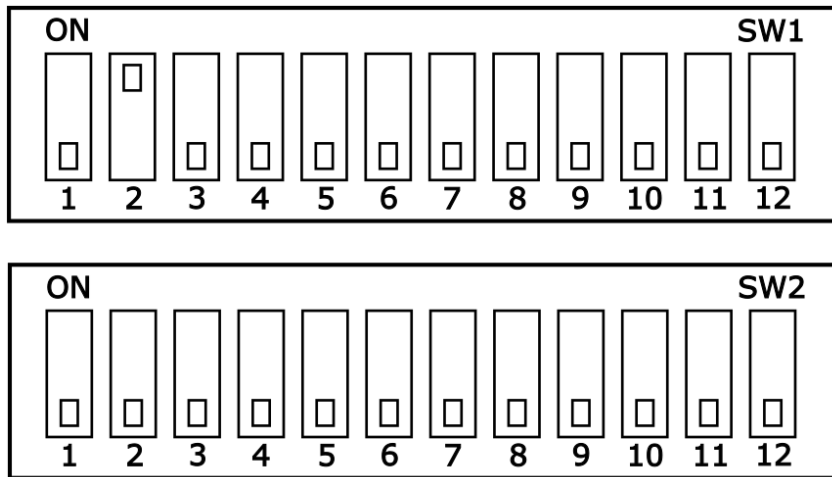

*Note: Figure 3 shows the DIP switch setting for UI-2, to configure UI-3/4/5 set switch 3/4/5.

Fig. 3

4-20mA Input

The DIP switch setting for a 4-20mA input is OFF for both switches as seen in figure 4 below. Also, a 169-ohm resistor is required. The resistor is wired across the signals +/- terminals as seen in figure 5 below.

The input signal is scaled using the min-pressure-value property (integers only), of the Analog Input Object, for the zero and max-pressure-value for the range (integers only). The sensor value will be displayed on the present value property of the Analog Input. If you need to set the input for a sensor that is -.5 to +.5, set the input to -5 to +5 and adjust your setpoint accordingly.

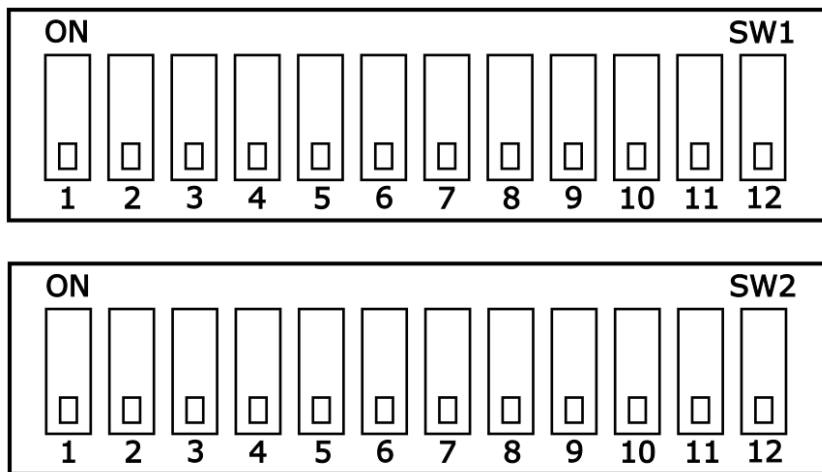


Fig. 4


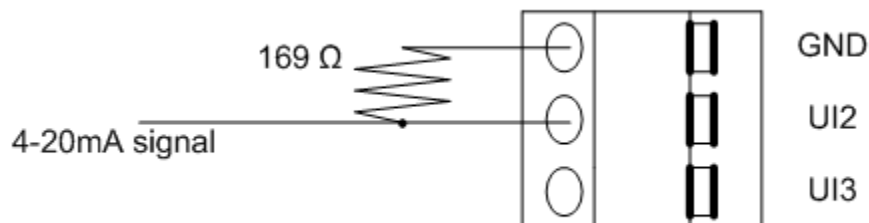


Fig. 5

0-5V or 0-10V Input

The DIP switch setting for a voltage input is to set switch 2/3/4/5 on SW2 for the respective input, see figure 6*.

The input signal is scaled using the min-pres-value property (integers only), of the Analog Input Object, for the zero and max-pres-value for the range (integers only). The sensor value will be displayed on the present value property of the Analog Input. If you need to set the input for a sensor that is -.5 to +.5, set the input to -5 to +5 and adjust your setpoint accordingly.

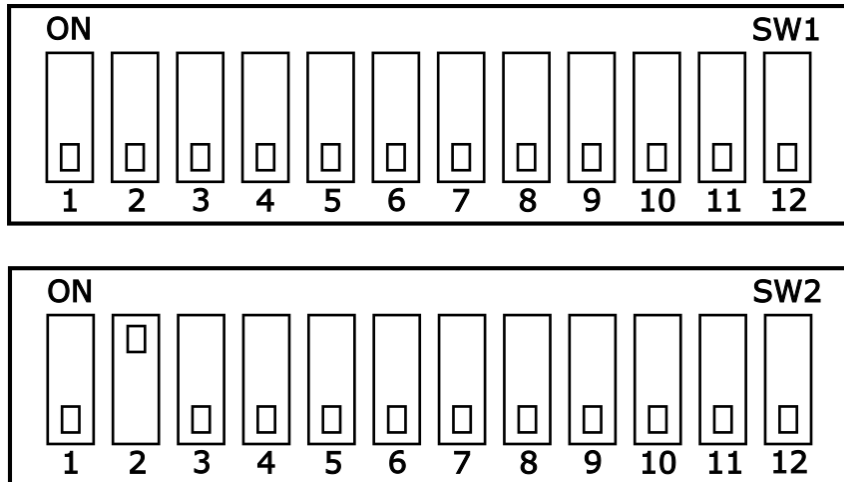

*Note: Figure 6 shows the DIP switch setting for UI-2, to configure UI-3/4/5 set switch 3/4/5 on SW2.

Fig. 6

Analog Output Setup

The analog outputs for the thermostat require no hardware setup. The maximum and minimum output signal can be adjusted using the max-press-value (integers only) and min-press-value (integers only) properties of the Analog Output Object. By default, depending on the model, the two outputs will modulate between 0 and 10 volts based on a 0-100% control signal.

Binary Input Setup

The binary inputs for the thermostat require no setup. The digital status of each universal input is updated continuously, whether they are being used or not. The input is active low. A zero-volt signal will show the BI ACTIVE. Any input signal higher than zero volts will show the BI as INACTIVE.

It is recommended to set AV-30 through AV-35 to a value of 0 (counts) for any required binary input.

Binary Output Setup

The binary outputs for the thermostat require no setup. The outputs are active high. The Common Relay input (BO HOT) is used to switch 24VAC/DC to the thermostat's relays. BO-5 is a logical point only and is used for occupancy scheduling only.